

Application FP03

Petroleum Flow Computer

for Quadrature Flowmeters



Features

- Volume correction according to ASTM D1250-04 and ASTM-IP-API Table 54
- Caters for wide range of petroleum products including crude, lube, refined and LPG
- Allows for volume correction of General and User fluids
- Accepts temperature and/or density inputs for volume correction
- Allows quadrature flow input for ISO 6551 level B pulse security
- Selection of second language and user tags
- RTC logging with over 1000 entries
- Programmable pulse width and scaling of pulse output
- 4-20mA retransmission
- RS-232 and RS-485 (optional) serial ports
- Modbus RTU, Printer and other serial port protocols
- Front panel adjustment of 8-24V DC output voltage
- Backlit display



Overview

The 515 FP03 application caters for custody transfer measurement of petroleum products. The frequency flow inputs can accept a quadrature signal for ISO 6551 level B pulse security. An analog temperature and/or density input allows for volume correction to reference conditions.

This instrument is compatible with a wide range of flowmeter frequency outputs, including millivolt signals, reed switches, Namur proximity switches and pulse trains via its smart front-panel program selection.

The flow computer displays the net and gross flowrates, resettable and accumulated totals. It can be used to measure a range of crude and refined petroleum fluids including gasoline, jet fuels, heating oils, diesels, lube oils and LPGs.

Calculations

The volume total and flowrate are derived from accurately measured frequency and the number of received pulses.

$$volume = pulses / k-factor$$


$$volume\ flow = frequency / k-factor$$

The volume correction calculations are based on the ASTM D1250-04 and API Table 54 standard for the following products:

- Crude Oils
- Lube Oils
- Refined Products
- Light Hydrocarbon Liquids (LPG)

Volume correction for other fluids can be calculated by the following means:

- General Coefficient of Expansion
- Preprogrammed User Table

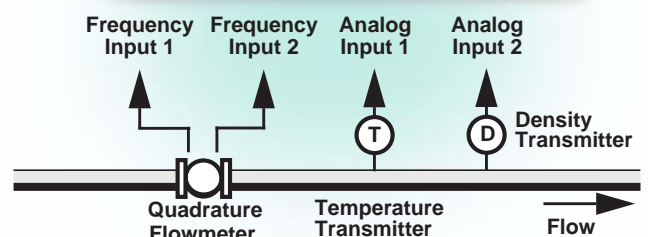

Displayed Information

The front panel display shows the current values of the input variables and the results of the calculations. A list of the variables for this application and their type (total or rate) is shown at the end of this document.

The instrument can be supplied with a real-time clock for data logging of over 1000 entries of the variables as displayed on the main menu.

Communications

There are two communication ports available as follows:

- RS-232 port
- RS-485 port (optional)

The ports can be used for remote data reading, printouts and for initial application loading of the instrument.

Isolated Outputs

The opto-isolated outputs can re-transmit any main menu variable. The type of output is determined by the nature of the assigned variable. Totals are output as pulses and rates are output as 4-20mA signals. One output is standard, a second output is available as an option.

Relay Outputs

The relay alarms can be assigned to any of the main menu variables of a rate type. The alarms can be fully configured including hysteresis. Two relays are standard with additional two relays available as an option.

Software Configuration

The instrument can be further tailored to suit specific application needs including units of measurement, custom tags, second language or access levels. A distributor can configure these requirements before delivery.


Instrument parameters including units of measurement can be programmed in the field, according to the user access levels assigned to parameters by the distributor.

Dimension Drawings

Part Number

515.XXXXXX-FP03
see **Product Codes** to select required features

Default Application software:
515-FP03-000000

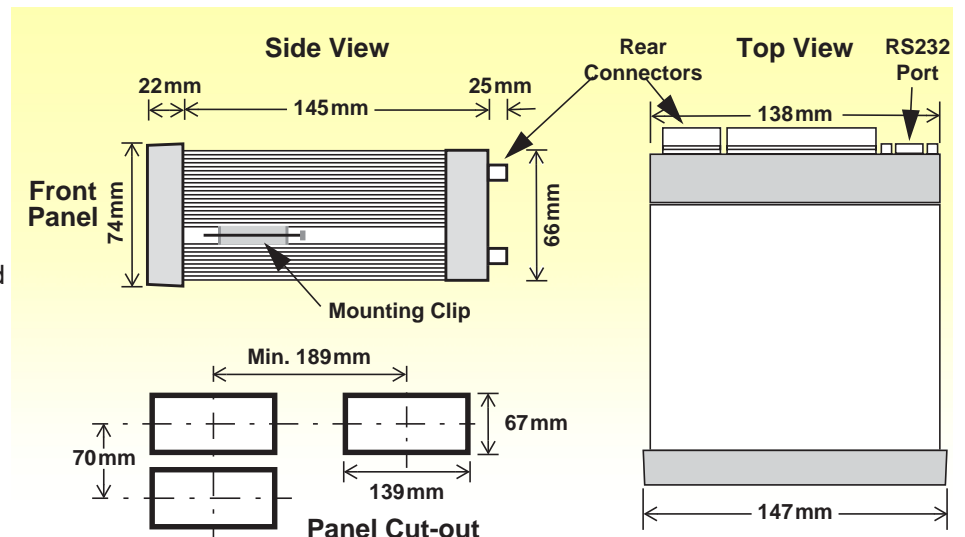

All set-up parameters, totals and logged data are stored in non-volatile memory with at least 30 years retention.

Temperature and Density Input Types

Temperature sensor input(s) can be either PT100, PT500, 4-20mA, 0-5V or 1-5V signals. Density sensor input(s) can be either 4-20mA, 0-5V or 1-5V signals.

Terminal Designations

| Terminal Label | Designation | Comment |
|----------------|--------------|------------------------|
| 1 | FINP 1+ | Frequency Input 1+ |
| 2 | FINP 2+ | Frequency Input 2+ |
| 3 | SG | Signal ground |
| 5 | EXC V | Excitation Term 2+ |
| | | For AINP1 RTD Input |
| 7 | AINP1 + | Analog Input ch 1 (+) |
| 8 | AINP1 - | Analog Input ch 1 (-) |
| | | Temperature Input |
| 9 | AINP2 + | Analog Input ch 2 (+) |
| 10 | AINP2 - | Analog Input ch 2 (-) |
| | | Density Input |
| 15 | Vo | 8-24 volts DC output |
| 16 | G | DC Ground |
| 17 | Vi | DC power input |
| 18 | SH | Shield terminal |
| | | Overload protected |
| 19 | | RS485 (+) |
| 20 | RS485 | RS485 (-) |
| 21 | | RS485 ground |
| | | Optional RS485 port |
| 22 | | 1+ Switch 1 |
| 23 | | 2+ Switch 2 |
| 24 | LOGIC INPUTS | 3+ Switch 3 |
| 25 | | 4+ Switch 4 |
| 26 | | C- Signal ground |
| 27 | | + Output ch 1 (+) |
| 28 | OUT1 | - Output ch 1 (-) |
| 29 | | + Output ch 2 (+) |
| 30 | OUT2 | - Output ch 2 (-) |
| | | Optional output |
| 31 | | RC Relay common |
| 32 | | R1 Relay 1 |
| 33 | RELAYS | R2 Relay 2 |
| 34 | | R3 Relay 3 |
| 35 | | R4 Relay 4 |
| | | Optional relays |
| E | | E Mains ground |
| N | AC MAINS | N Mains neutral |
| A | | A Mains active |
| | | AC power in 100-240VAC |
| | RS232 port | 9-pin serial port |

Specifications

Operating Environment

| | |
|--------------------------------------|--|
| Temperature | -20°C to +60°C (conformal coating) +5°C to +40°C (no coating) |
| Humidity | 0 to 95% non condensing (conformal coating) 5% to 85% non condensing (no coating) |
| Power Supply | 100-240 V AC (+/-10%) 50-60 Hz (+/-10%) or 12-28 V DC |
| Consumption | 6W (typical) |
| Protection | Sealed to IP65 (Nema 4X) when panel mounted |
| Dimensions (panel option) | 147mm (5.8") width 74mm (2.9") height 167mm (6.6") depth |

Display

| | |
|--------------------|---|
| Type | Backlit LCD with 7-digit numeric display and 11-character alphanumeric display |
| Digits | 15.5mm (0.6") high |
| Characters | 6mm (0.24") high |
| LCD Backup | Last data visible for 15min after power down |
| Update Rate | 0.3 second |

Non-volatile Memory

| | |
|--------------------|------------------------|
| Retention | > 30 years |
| Data Stored | Setup, Totals and Logs |

Approvals

| | |
|---------------------|--|
| Interference | CE compliance |
| Enclosure | IECEX, ATEX and CSA approved enclosures available for hazardous areas |

Real Time Clock (Optional)

| | |
|---------------------|--------------------------------------|
| Battery Type | 3 volts Lithium button cell (CR2032) |
| Battery Life | 5 years (typical) |

Frequency Input (General)

| | |
|-------------------------|--------------------------------------|
| Range | 0 to 10kHz (3kHz for pulse security) |
| Overvoltage | 30V maximum |
| Update Time | 0.3 sec |
| Cutoff frequency | Programmable |
| Configuration | Pulse, coil or NPS input |
| Non-linearity | Up to 10 correction points |

Pulse

| | |
|--------------------|--|
| Signal Type | CMOS, TTL, open collector, reed switch |
| Threshold | 1.3 volts |

Coil

| | |
|--------------------|-----------------------|
| Signal Type | Turbine and sine wave |
| Sensitivity | 15mV p-p minimum |

NPS

| | |
|--------------------|------------------------------|
| Signal Type | NPS sensor to Namur standard |
|--------------------|------------------------------|

Analog Input (General)

| | |
|----------------------|--|
| Overcurrent | 100mA absolute maximum rating |
| Update Time | < 1.0 sec |
| Configuration | RTD, 4-20mA, 0-5V and 1-5V input |
| Non-linearity | Up to 20 correction points (some inputs) |

RTD Input

| | |
|--------------------|---------------------------------|
| Sensor Type | PT100 & PT500 to IEC 751 |
| Connection | Four Wire |
| Range | -200°C to 350°C |
| Accuracy | 0.1°C typical (-100°C to 300°C) |

4-20mA Input

| | |
|------------------|---|
| Impedance | 100 Ohms (to common signal ground) |
| Accuracy | 0.05% full scale (20°C) 0.1% (full temperature range, typical) |

0-5 or 1-5 Volts Input

| | |
|------------------|---|
| Impedance | 10MOhms (to common signal ground) |
| Accuracy | 0.05% full scale (20°C) 0.1% (full temperature range, typical) |

Logic Inputs

| | |
|--------------------|--|
| Signal Type | CMOS, TTL, open collector, reed switch |
| Overvoltage | 30V maximum |

Relay Output

| | |
|-----------------------|---|
| No. of Outputs | 2 relays plus 2 optional relays |
| Voltage | 250 volts AC, 30 volts DC maximum (solid state relays use AC only) |
| Current | 3A maximum |

Communication Ports

| | |
|------------------|---------------------------------------|
| Ports | RS-232 port RS-485 port (optional) |
| Baud Rate | 2400 to 19200 baud |
| Parity | Odd, even or none |
| Stop Bits | 1 or 2 |
| Data Bits | 8 |
| Protocols | ASCII, Modbus RTU, Printer* |

Transducer Supply

| | |
|-------------------|---------------------------------|
| Voltage | 8 to 24 volts DC, programmable |
| Current | 70mA @ 24V, 120mA @ 12V maximum |
| Protection | Power limited output |

Isolated Output

| | |
|-----------------------|---|
| No. of Outputs | 1 configurable output (plus 1 optional) |
| Configuration | Pulse/Digital or 4-20mA output |

Pulse/Digital Output

| | |
|--------------------|---|
| Signal Type | Open collector |
| Switching | 200mA, 30 volts DC maximum |
| Saturation | 0.8 volts maximum |
| Pulse Width | Programmable: 10, 20, 50, 100, 200 or 500ms |

4-20mA Output

| | |
|-------------------|---|
| Supply | 9 to 30 volts DC external |
| Resolution | 0.05% full scale |
| Accuracy | 0.05% full scale (20°C) 0.1% (full temperature range, typical) |

*Important: Specifications are subject to change without notice.
Printer protocol is available only if RTC option is installed.*

Ordering Information

Product Codes

| Model | Supplementary Code | Description |
|-------------------------|--------------------|---|
| 515 | - FP03 | |
| Enclosure | 1 | Panel mount enclosure |
| | 2 | Field mount enclosure (NEMA 4X / IP66) |
| | 3/5 | Explosion proof Ex d (IECEX/ATEX), metric glands (5 specifies heater) |
| | 4/6 | Explosion proof Ex d (CSA), NPT glands (6 specifies heater) |
| Output Options | 0 | 4 logic inputs, 1 isolated output, 2 relays (only relay type 1 is available), RS232 (DB9) communication port |
| | 1 | 4 logic inputs, 2 isolated outputs, 4 relays, real-time clock data logging, RS232 (DB9) and RS485 communication ports |
| | 2/3 | 4 logic inputs, 2 isolated outputs, 4 relays, real-time clock data logging, RS232 (DB9) and Ethernet/RF communication ports (not yet available) |
| Relay Type | 1 | Electromechanical relays only |
| | 2 | 2 electromechanical and 2 solid state relays |
| | 3 | Solid state relays only (not yet available) |
| Power Supply | U | Inputs for 12-28VDC and 100-240 VAC, 50-60Hz (Previous Models: A = 110/120 VAC, E = 220/240 VAC) |
| | D | Input for 12-28VDC power only |
| Display Panel Option | S | Standard option (now with backlight & LCD backup) (original Full option: F, with Infra-Red comms, no longer available) |
| PCB Protection | C | Conformal coating - required for maximum environmental operating range. Recommended to avoid damage from moisture and corrosion. |
| | N | None - suitable for IEC standard 654-1 Climatic Conditions up to Class B2 (Heated and/or cooled enclosed locations) |
| Application Pack Number | FP03 | Defines the application software to be loaded into the instrument |

Example full product part number is 515.111USC-FP03 (this is the number used for placing orders).

Main Menu Variables

| Main Menu Variables | Default Units | Preferred Units | Variable Type |
|---------------------|---------------------|-----------------|---------------|
| Net Volume | m ³ | | Total |
| Net Flowrate | m ³ /min | | Rate |
| Gross Volume | m ³ | | Total |
| Gross Flowrate | m ³ /min | | Rate |
| Mass | kg | | Total |
| Mass Flowrate | kg/min | | Rate |
| Temperature | Deg C | | Rate |
| Density | kg/m ³ | | Rate |



500 Series in Ex410 Enclosure

www.contrec.co.uk



Contrec Limited
Riverside, Canal Road
Sowerby Bridge, West Yorkshire
HX6 2AY United Kingdom
Tel: +44 1422 829944
Email: sales@contrec.co.uk

Contrec - USA, LLC
916 Belcher Drive
Pelham, Alabama
AL 35124 United States
Tel: +1 (205) 685 3000
Email: contrec@contrec-usa.com

Contrec Systems Pty Ltd
5 Norfolk Avenue
Ringwood, Victoria 3134
Melbourne Australia
Tel: +61 413 505 114
Email: info@contrec.com.au